


NOTES:

1. CONCRETE TYPE II PORTLAND CEMENT ASTM C 260-86. MINIMUM COMPRESSIVE STRENGTH 3,000 PSI AT 28 DAYS.
2. PIPE SEAL DETAIL SEE SPECIFICATION SHEET NO. S-249.
3. REINFORCING BAR ASTM GRADE 40. REINFORCING BAR NO. 4.
4. STRUCTURAL CALCULATIONS AVAILABLE UPON REQUEST.

PIPE SEAL SEE NOTE NO. 2

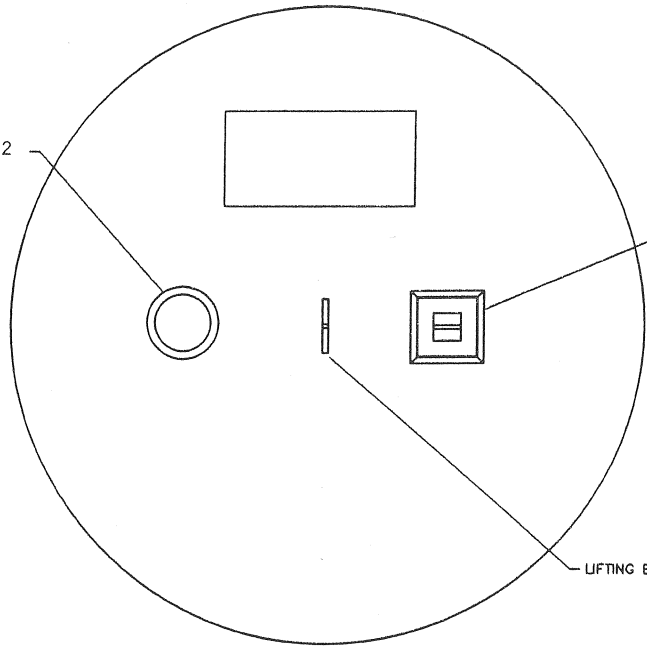


INSPECTION PLUG 9" x 9" / 11" x 11"

LIFTING EYE

PLAN VIEW

DIMENSIONS			
PIT COVER DIAMETER	A	B	C
4 FOOT	48"	30"	4"
5 FOOT	60"	42"	4"

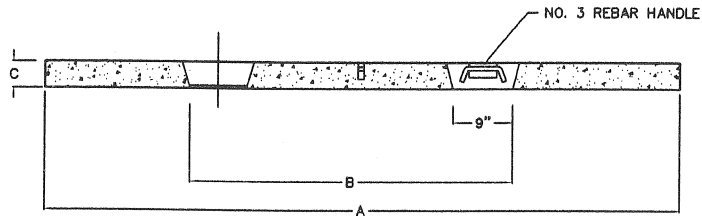

SECTION

SEEPAGE PIT COVERS
4' AND 5' DIAMETERS



P.O. BOX 602
HIGHLAND, CA 92346
909 793-7602 800 945-8265
Fax: 909 793-1283

DATE:
10-1-01

DRAWN BY:
B. BRAKE

SCALE:
1" = 1'

DWG #
1113-D1