


SECTION

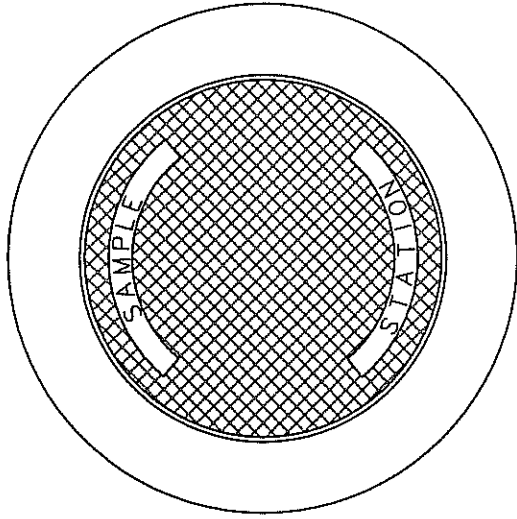

PLAN VIEW

NOTES:

1. COVER AND FRAME ARE CAST OF GRAY IRON CONFORMING TO ASTM A-48, FEDERAL SPECIFICATIONS RR-F-621C. MINIMUM TENSILE STRENGTH OF THE MATERIAL SHALL BE 30,000 PSI.
2. ALL BEARING SURFACES ARE MACHINED.
3. CASTING SHALL BE OF UNIFORM QUALITY, FREE FROM BLOW HOLES DISTORTION DEFECTS. THE FIT AND FINISH SHALL MEET INDUSTRY STANDARDS BEING WELL CLEANED BY SHOT BLASTING PRIOR TO RECEIVING COATING.
4. STANDARD COATING SHALL BE BLACK ASPHALT BASED DIP COATING.
5. THE SET SHALL BE RATED FOR H-20 VEHICLE LOADING.
6. THE SET SHALL HAVE A COMBINED WEIGHT OF 85 POUNDS WITH A COVER WEIGHT OF 65 POUNDS AND A FRAME WEIGHT OF 20 POUNDS.

SAMPLE STATION COVER



P.O. BOX 602
HIGHLAND, CA 92346
909 793-7602 800 945-8265
Fax: 909 793-1283

DATE:
12-6-99

DRAWN BY:
B. BRAKE

SCALE:
1" = 1'

DWG #
1136