


PLAN VIEW

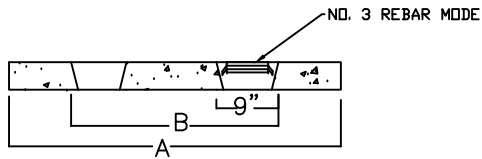

SECTION A-A

NOTES:

1. CONCRETE TYPE II PORTLAND CEMENT ASTM C 260-86
MINIMUM COMPRESSIVE STRENGTH 4000PSI AT 28 DAYS.
2. PIPE SEAL DETAIL SPECIFICATION SHEET NO. S-249.
3. REINFORCING BAR ASTM A 615 GRADE 60. REINFORCING BAR
#4 @ 6" O.C.
4. DESIGN IN ACCORDANCE W/ ASTM C1227 AND HS-20 LOADING
5. MINIMUM EARTH FILL COVER 3'-0"

| PIT COVER DIA. | EXCAVATION SPECIFICATIONS | | |
|----------------|---------------------------|-----|----|
| | A | B | C |
| 4 FOOT | 48" | 30" | 4" |
| 5 FOOT | 60" | 42" | 6" |
| 6 FOOT | 72" | 54" | 8" |

SEEPAGE PIT COVERS
4', 5' AND 6' DIAMETERS



P.O. BOX 602
HIGHLAND, CA 92346
909 793-7602 800 945-8265
Fax: 909 793-1283

DATE:
04-16-13

DRAWN BY:
M. RAHMAN

SCALE:

DWG #
1113-D1